


TOP VIEW

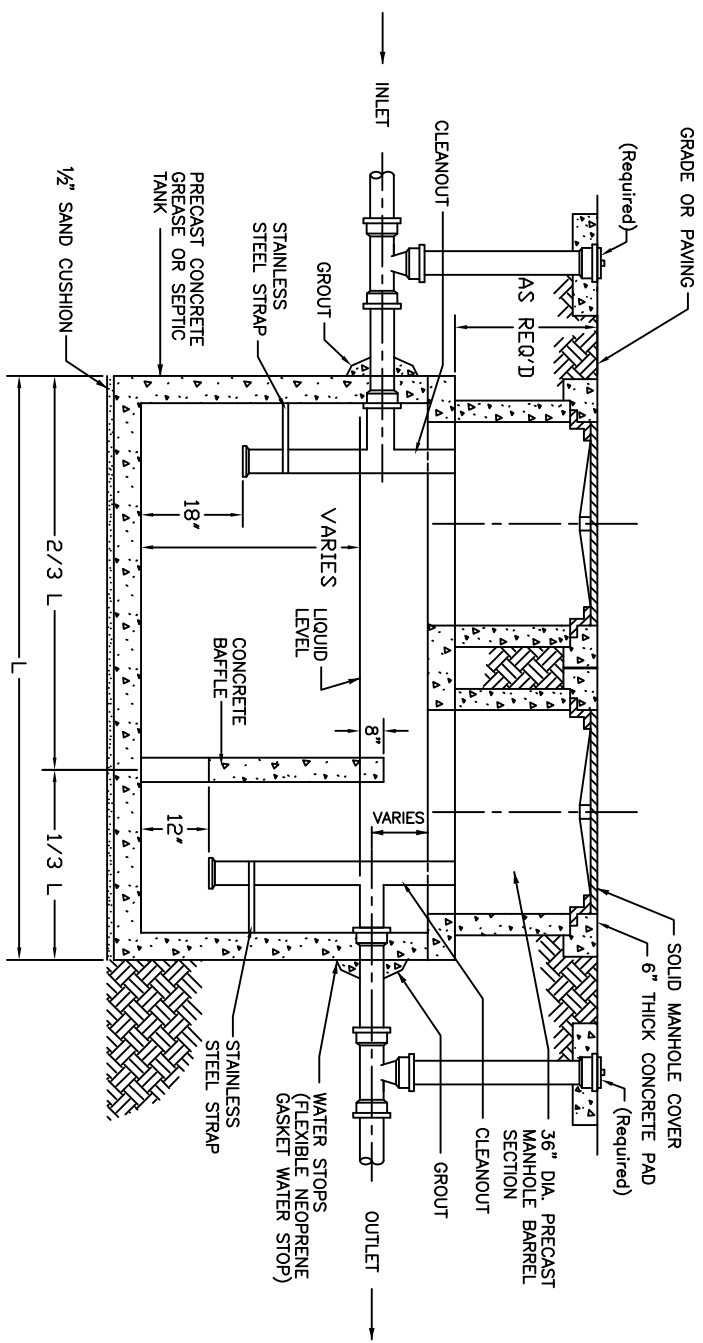

SECTION

GENERAL NOTES:

1. THIS STRUCTURE IS TO BE ACCESSIBLE FOR MAINTENANCE OR INSPECTION WITH COVERS AND CLEANOUTS BROUGHT TO GRADE.
2. DESIGN CRITERIA SHALL BE HS-20 LOADING.
3. FLOW TO THE INTERCEPTOR SHALL EXCLUDE SANITARY SEWAGE AND SURFACE DRAINAGE.
4. DESIGN AND CAPACITY OF GREASE INTERCEPTOR TO BE CERTIFIED BY ENGINEER IN ACCORD WITH KENTUCKY STATE PLUMBING CODE AND REVIEWED FOR CAPACITY BY THE DIVISION OF ENGINEERING PRIOR TO CONSTRUCTION.
5. MULTIPLE COMPARTMENT INTERCEPTORS ARE REQUIRED.
6. PIPE CLEANOUT TEE SHALL BE THE SAME SIZE AS THE PIPE AND BE WITHIN 6" OF THE GREASE INTERCEPTOR ON THE OUTLET LINE.
7. MANUFACTURER WILL PROVIDE GREASE TRAP WITH TWO(2) ACCESS POINTS AS SHOWN. PLUMBING CONTRACTOR TO INSTALL FIXTURES AS SHOWN.
8. THE MINIMUM CAPACITY OF INTERCEPTORS IS 1000 GALLONS.

NO.	DATE	REVISION DESCRIPTION	BY

DIVISION OF ENGINEERING
 GREASE INTERCEPTOR
 TYPICAL
 CONFIGURATION

STANDARD DRAWING NO. _____
 APPROVAL: _____
 URBAN COUNTY ENGINEER _____ DATE _____
 COMMISSIONER _____ DATE _____